

**Fig. 1: UV Spectrophotometer Readings**  
**2500 ppm Hydrogen Peroxide: 25000 ppm Sodium Hypochlorite**  
**Baseline 2500 ppm Hydrogen Peroxide**

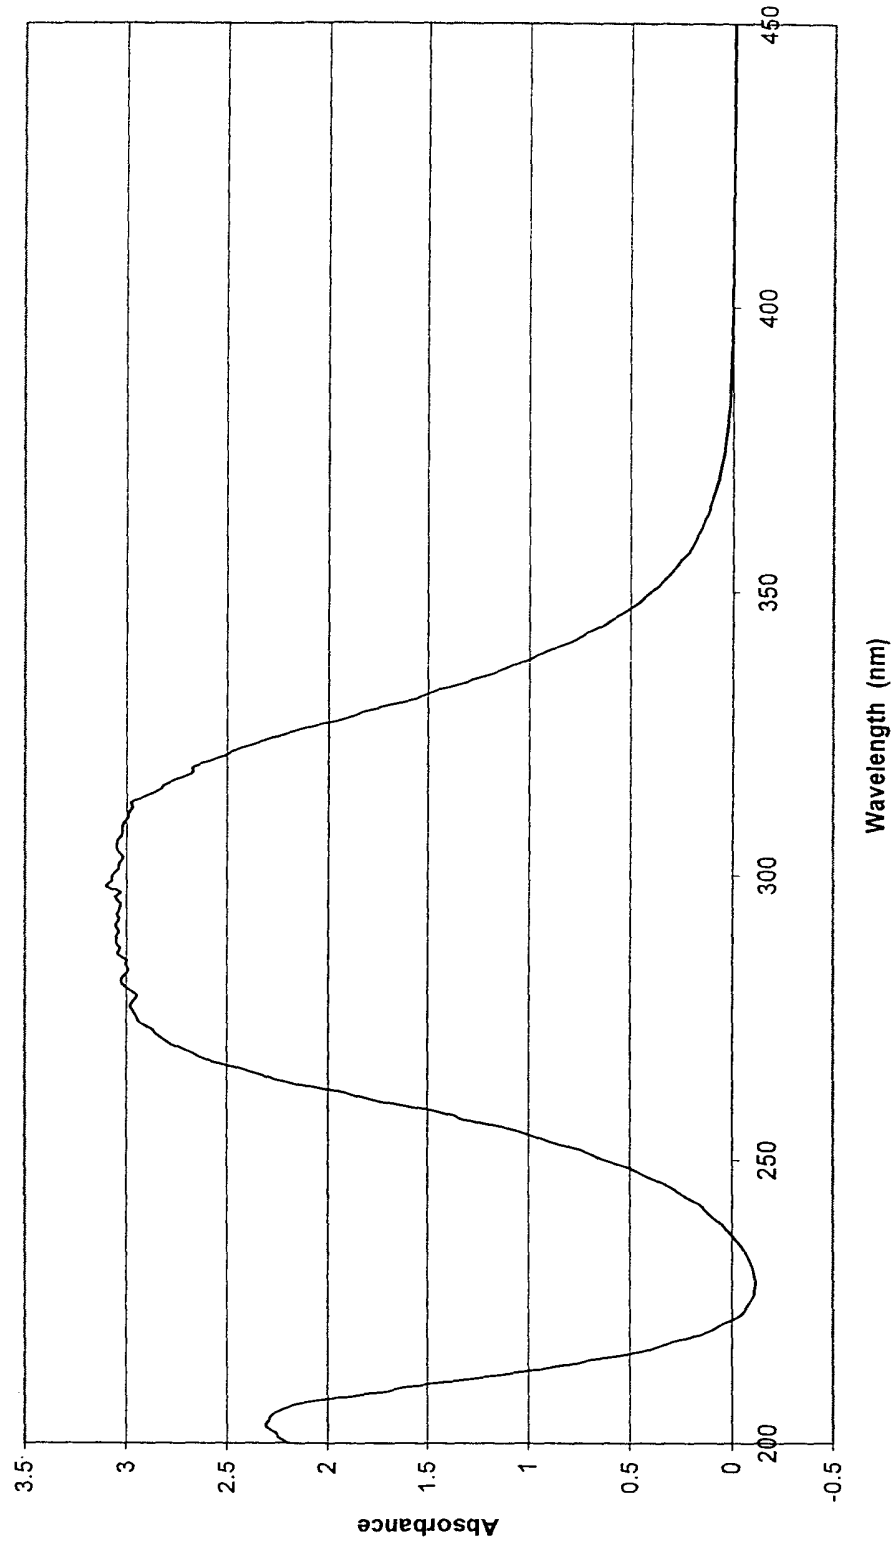


Fig. 2

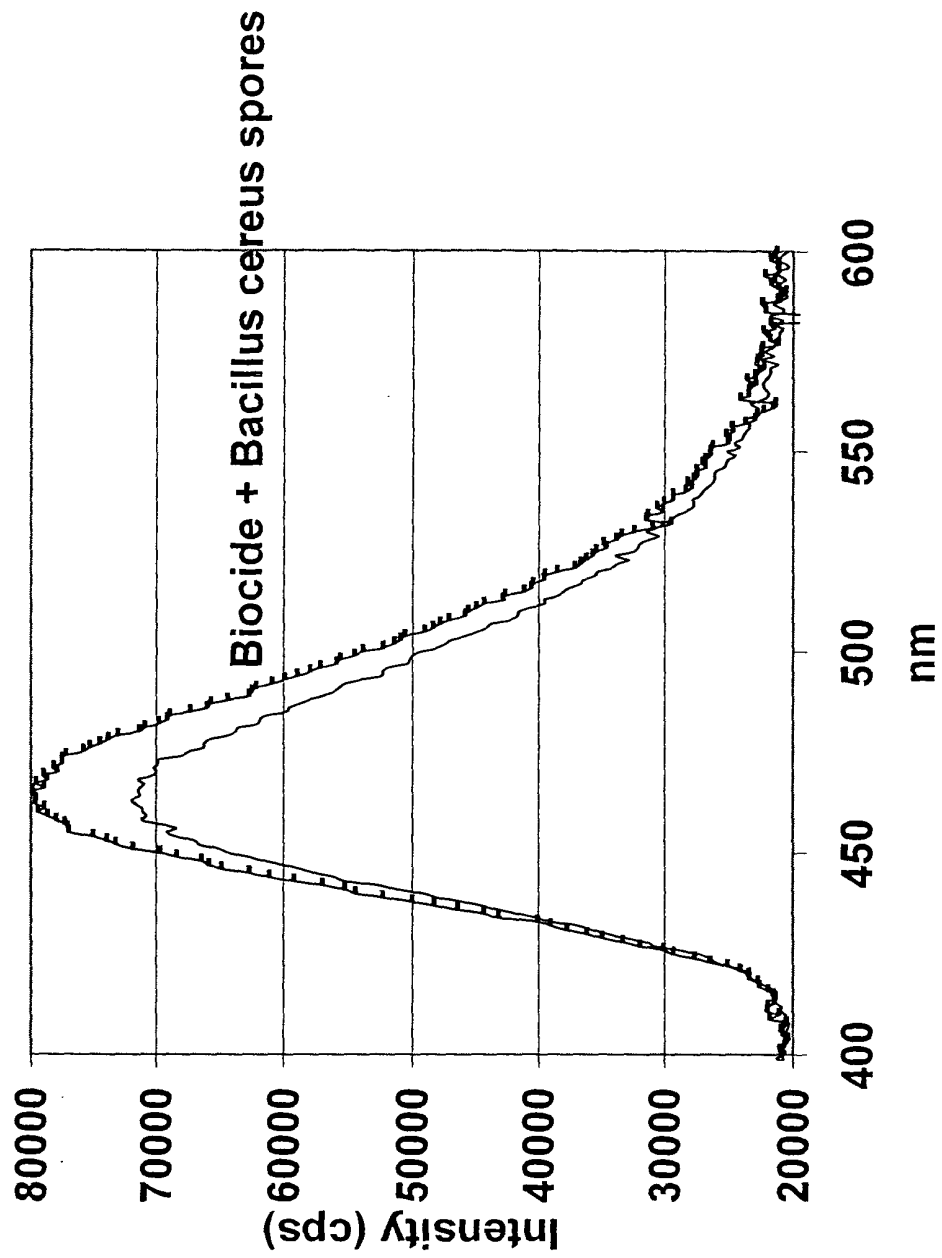


Fig. 3: Spectrophotometer Readings  
2500 ppm Hydrogen Peroxide: 25000 ppm Sodium Hypochlorite Mixture  
Baseline 2500 ppm Hydrogen Peroxide

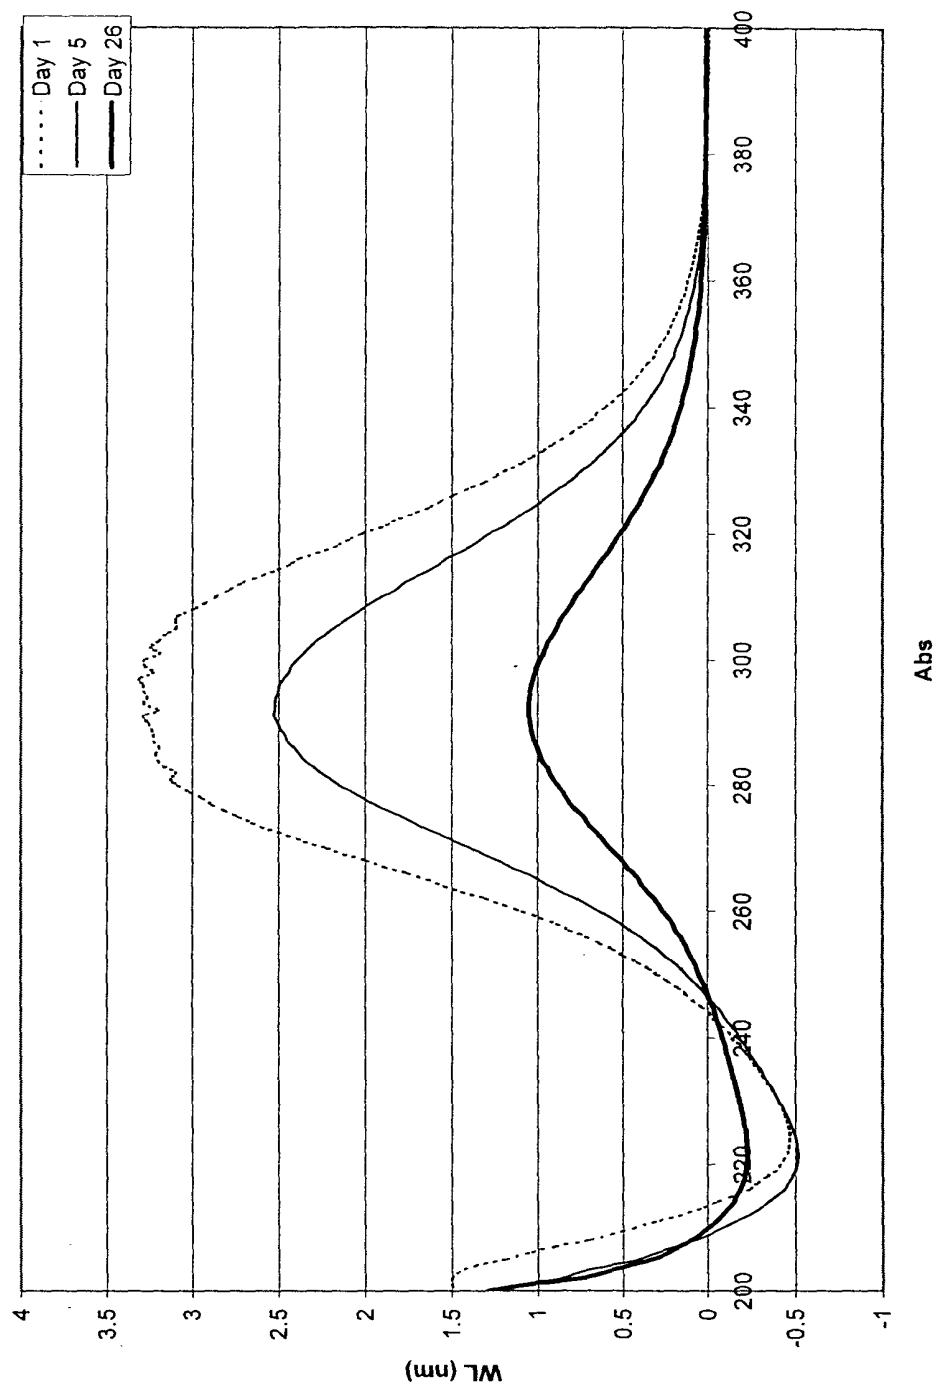


Fig. 4: Spectrophotometer Readings  
2500 ppm Hydrogen Peroxide: 25000 ppm Sodium Hypochlorite Mixture  
Baseline 25000 ppm Sodium Hypochlorite

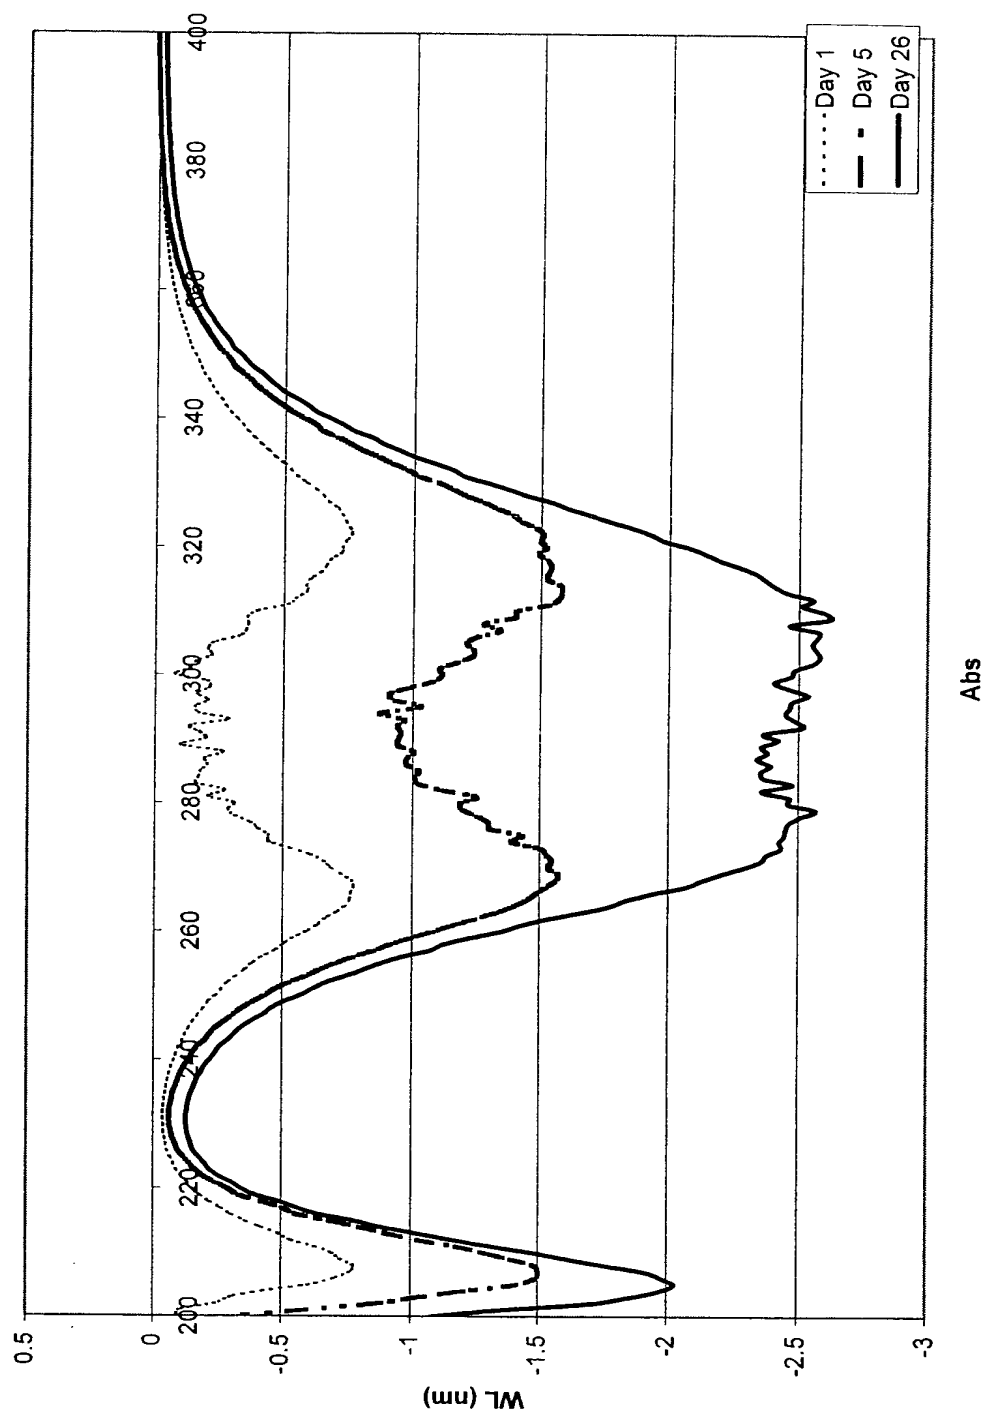


Fig. 5

